



BSI Standards Publication

Low-voltage surge protective devices

Part 11: Surge protective devices connected to low-voltage power systems - Requirements and test methods

National foreword

This British Standard is the UK implementation of EN 61643-11:2012+A11:2018. It is derived from IEC 61643-11:2011. It supersedes BS EN 61643-11:2012, which is withdrawn.

The CENELEC common modifications to this document have been provided in their entirety in the European Endorsement Notice. BSI's policy of providing consolidated content remains unchanged; however, in the interest of expediency, in this instance BSI have chosen to collate the relevant content at the beginning of this document.

The UK participation in its preparation was entrusted to Technical Committee PEL/37/1, Surge Arresters - Low Voltage.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2018
Published by BSI Standards Limited 2018

ISBN 978 0 580 93590 9

ICS 29.240.01; 29.240.10

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 30 April 2018.

Amendments/corrigenda issued since publication

Date	Text affected
30 April 2018	Implementation of CENELEC amendment A11:2018: European foreword and Annex ZA amended, Subclause 7.5.5 and Annexes ZC and ZZ added

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 61643-11
+A11:2018

October 2012

ICS 29.240; 29.240.10

English version

**Low-voltage surge protective devices -
Part 11: Surge protective devices connected to low-voltage power
systems -
Requirements and test methods
(IEC 61643-11:2011, modified)**

Parafoudres basse tension -
Partie 11: Parafoudres connectés aux
systèmes basse tension -
Exigences et méthodes d'essai
(CEI 61643-11:2011, modifiée)

Überspannungsschutzgeräte für
Niederspannung -
Teil 11: Überspannungsschutzgeräte für
den Einsatz in Niederspannungsanlagen -
Anforderungen und Prüfungen
(IEC 61643-11:2011, modifiziert)

This European Standard was approved by CENELEC on 2012-08-27. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

CENELEC

European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

Management Centre: Avenue Marnix 17, B - 1000 Brussels

European foreword

This document (EN 61643-11:2012) consists of the text of IEC 61643-11:2011 prepared by IEC/SC 37A "Low-voltage surge protective devices", together with the common modifications prepared by CLC/TC 37A "Low voltage surge protective devices".

The following dates are fixed:

- latest date by which this document has to be implemented (dop) 2013-08-27
at national level by publication of an identical national standard or by endorsement
- latest date by which the national standards conflicting with this document have to be withdrawn (dow) 2015-08-27

This document supersedes EN 61643-11:2002 + A11:2007.

The main changes with respect of EN 61643-11:2002 + A11:2007 are the complete restructuring and improvement of the test procedures and test sequences.

Clauses, subclauses, notes, tables, figures and annexes which are additional to those in IEC 61643-11:2011 are prefixed "Z".

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC [and/or CEN] shall not be held responsible for identifying any or all such patent rights.

This standard covers the principle elements and objectives for electrical equipment designed for use within certain voltage limits (LVD - 2014/35/EU).

Foreword to amendment A11

This document (EN 61643-11:2012/A11:2018) has been prepared by CLC/TC 37A "Low voltage surge protective devices".

The following dates are fixed:

- latest date by which this document has to be implemented at national level by publication of an identical national standard or by endorsement (dop) 2018-09-23
- latest date by which the national standards conflicting with this document have to be withdrawn (dow) 2021-03-23

Annex ZC applies to portable SPDs classified as pluggable equipment type A according to EN 62368-1.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC shall not be held responsible for identifying any or all such patent rights.

This document has been prepared under a mandate given to CENELEC by the European Commission and the European Free Trade Association, and supports essential requirements of EU Directive(s).

For the relationship with EU Directive(s) see informative Annex ZZ, which is an integral part of this document.

Endorsement notice

The text of the International Standard IEC 61643-11:2011 was approved by CENELEC as a European Standard with agreed common modifications.

COMMON MODIFICATIONS

Scope *Modify the Scope as follows:*

This part of EN 61643 is applicable to devices for surge protection against indirect and direct effects of lightning or other transient overvoltages. These devices are called Surge Protective Devices (SPD). These devices are designed to be connected to 50 Hz a.c. power circuits, and equipment rated up to 1 000 V r.m.s. Performance characteristics, safety requirements, standard methods for testing and ratings are established. These devices contain at least one nonlinear component and are intended to limit surge voltages and divert surge currents.

3.1.14 *Modify the note as follows:*

- the measured limiting voltage, determined for front-of-wave sparkover (if applicable) and the measured limiting voltage, determined from the residual voltage measurements up to I_n and/or I_{imp} respectively for test classes II and/or I
- the measured limiting voltage determined for the combination wave measurements up to U_{oc} for test class III.

3.1.28 *Modify the definition as follows:*

SPD disconnecter (disconnecter)

device for disconnecting an SPD, or part of an SPD, from the power system in the event of SPD failure

NOTE This disconnecting device is not required to have isolating capability for safety purposes. It is to prevent a persistent fault on the system and is used to give an indication of an SPD's failure. Disconnectors can be either internal (built in) or external (required by the manufacturer) or both. There may be more than one disconnector function, for example an over-current protection function and a thermal protection function. These functions may be in separate units.

3.1.36 *Modify the heading definition as follows:*

sparkover voltage or trigger voltage of a voltage switching SPD

3.1.39 *Add a note to the definition:*

NOTE According to installation standard HD 60364-5-534, I_n shall be equal to I_{sccr} .

4.1 *Modify the subclause as follows:*

Frequency range is from 47 Hz to 53 Hz a.c.

5.3 *Replace 5.3 by the following:*

Types 1, 2 and 3 SPDs- Class I, II and III tests

Information required for class I, II and class III tests is given in Table 2.

Table 2 – Tests of types 1, 2 and 3 SPDs

Type of SPD	Tests	Required information	Test procedures (see subclauses)
Type 1	Class I	I_{imp}	8.1.1; 8.1.2; 8.1.3
Type 2	Class II	I_n	8.1.2; 8.1.3
Type 3	Class III	U_{oc}	8.1.4; 8.1.4.1

5.7.1.3 *Modify the title as follows:*

Both (one part internal and one part external)

5.8 *Delete text:*

According to IP code of IEC 60529.

5.10.1 *Modify the subclause as follows:*

AC between 47 Hz and 53 Hz.

5.10.2 *Modify the subclause as follows:*

AC other than the range of 47 Hz to 53 Hz.

6 *Replace complete clause by:* void

Table 1 *Delete row k dealing with k (trip current factor)*

7.1.1 *Modify a4) as follows:*

The SPD type and discharge parameters for each mode of protection declared by the manufacturer and printed next to each other:

- for Type 1: “Type 1” and “ I_{imp} ” and the value in kA, and/or “ $\overline{T1}$ ” (T1 in a square) and “ I_{imp} ” and the value in kA (e.g. $\overline{T1}$ I_{imp} : 10 kA);
- for Type 2: “Type 2” and “ I_n ” and the value in kA, and/or “ $\overline{T2}$ ” (T2 in a square) and “ I_n ” and the value in kA (e.g. $\overline{T2}$ I_n : 10 kA);
- for Type 3: “Type 3” and “ U_{oc} ” and the value in kV, and/or “ $\overline{T3}$ ” (T3 in a square) and “ U_{oc} ” and the value in kV (e.g. $\overline{T3}$ U_{oc} : 5 kV);

7.1.1 *Modify last paragraph of a8) as follows:*

An SPD may be classified according to more than one test class (e.g. Type 1 $\overline{T1}$ and Type2 $\overline{T2}$). In this case, the tests required for all declared test classes shall be performed. If in such case the manufacturer declares only one protection level, only the highest protection level shall appear in the marking.

7.1.1 *Modify b10) to read*

b10) void

7.1.1 *Modify b14) to read*

b14) I_{max} , (if declared by the manufacturer).

7.1.1 *Modify c7) to read*

c7) void

7.2.2 *Add a 3rd paragraph:*

This test is not performed on SPDs for connection N-PE only.

7.2.4 *Add after the first paragraph:*

The SPD shall bechanges in its characteristics.

“In addition voltage switching type SPDs or combination type SPDs shall be able to interrupt any follow current up to the short-circuit current rating (I_{scsr}).”

7.2.5.3 *Modify the 2nd paragraph to read:*

Compliance is checked by the test in accordance with 8.3.5.3 and 8.3.5.3.2.

7.2.5.3 *Remove the 3rd paragraph*

7.2.5.4 *Replace the 2nd paragraph by:*

A status indicator may be composed of two parts (one of which is not replaced when e.g. a plug module is changed), linked by a coupling mechanism which can be mechanical, optical, audio, electromagnetic, etc. The part of the status indicator which is not replaced (e.g. base part of socket) shall be capable of operating at least 50 times

7.4.5.1 *Replace reference to IEC 61000 series by reference to EN 61000-6-1.*

7.4.5.2 *Replace reference to IEC 61000 series by reference to EN 61000-6-3.*

7.6.1.2 *Add new requirement:*

7.6.1.2 Maximum discharge current I_{max}

If the manufacturer declares I_{max} this parameter shall be tested in accordance with the test in 8.3.3.1.

7.6.1.3 *Add new requirement:*

7.6.1.3 Vibration and shock

Information on vibration and shock tests for transportation and special applications can be found in Annex ZB.

8 *Modify the note as follows:*

NOTE For some tests, special prepared samples are required.

8.1 *Add the following Note after the 11th paragraph (second bullet):*

NOTE Tissue paper: thin, soft and rather strong paper, generally used to wrap breakable objects and whose weight stands between 12 g/m² and 25 g/m².

8.1 *Correct miss spelling at the end of 2nd line of the 10th paragraph:*

... is required for the L-PE ... (the t of the word the is missing)

Table 3 *Add footnote ^d to the line "Operating duty test" in Table 3.*

Table 3 *Add footnote ^d to read as follows (bottom of Table 3):*

^d For the whole operating duty test (including the additional duty test, if applicable) one separate set of samples may be used.

Table 3 *Replace the test description in test sequence 7 "For SPDs classified outdoor" to read:*

Environmental tests for outdoor SPDs

Table 3 *Replace in the line of test sequence 7 "O" by "-"*

Delete "O = optional" in Table 3 (bottom)

Table 3 *Add after Thermal stability "^c"*

Table 4, E criteria *Modify second paragraph as follows:*

The SPD shall be connected as for normal use according to the manufacturer's instructions to a power supply at the reference test voltage (U_{REF}). The current that flows through each terminal is measured. Its resistive component (momentary value of current measured at the crest of the voltage sine wave) shall not exceed a value of 1 mA, or the total current shall not have changed by more than 20 % compared to the initial value determined at the beginning of the relevant test sequence.

Table 4, E criteria *Modify fourth paragraph as follows:*

In addition, for SPD modes connected N-PE only the current through the PE-terminal shall be measured, whereas the terminals are connected to a power supply at the maximum continuous operating voltage (U_c). Its resistive component (momentary value of current measured at the crest of the voltage sine wave) shall not exceed a value of 1 mA, or the total current shall not have changed by more than 20 % compared to the initial value determined at the beginning of the relevant test sequence.

Table 5 *Delete line 8.3.5.3.1*

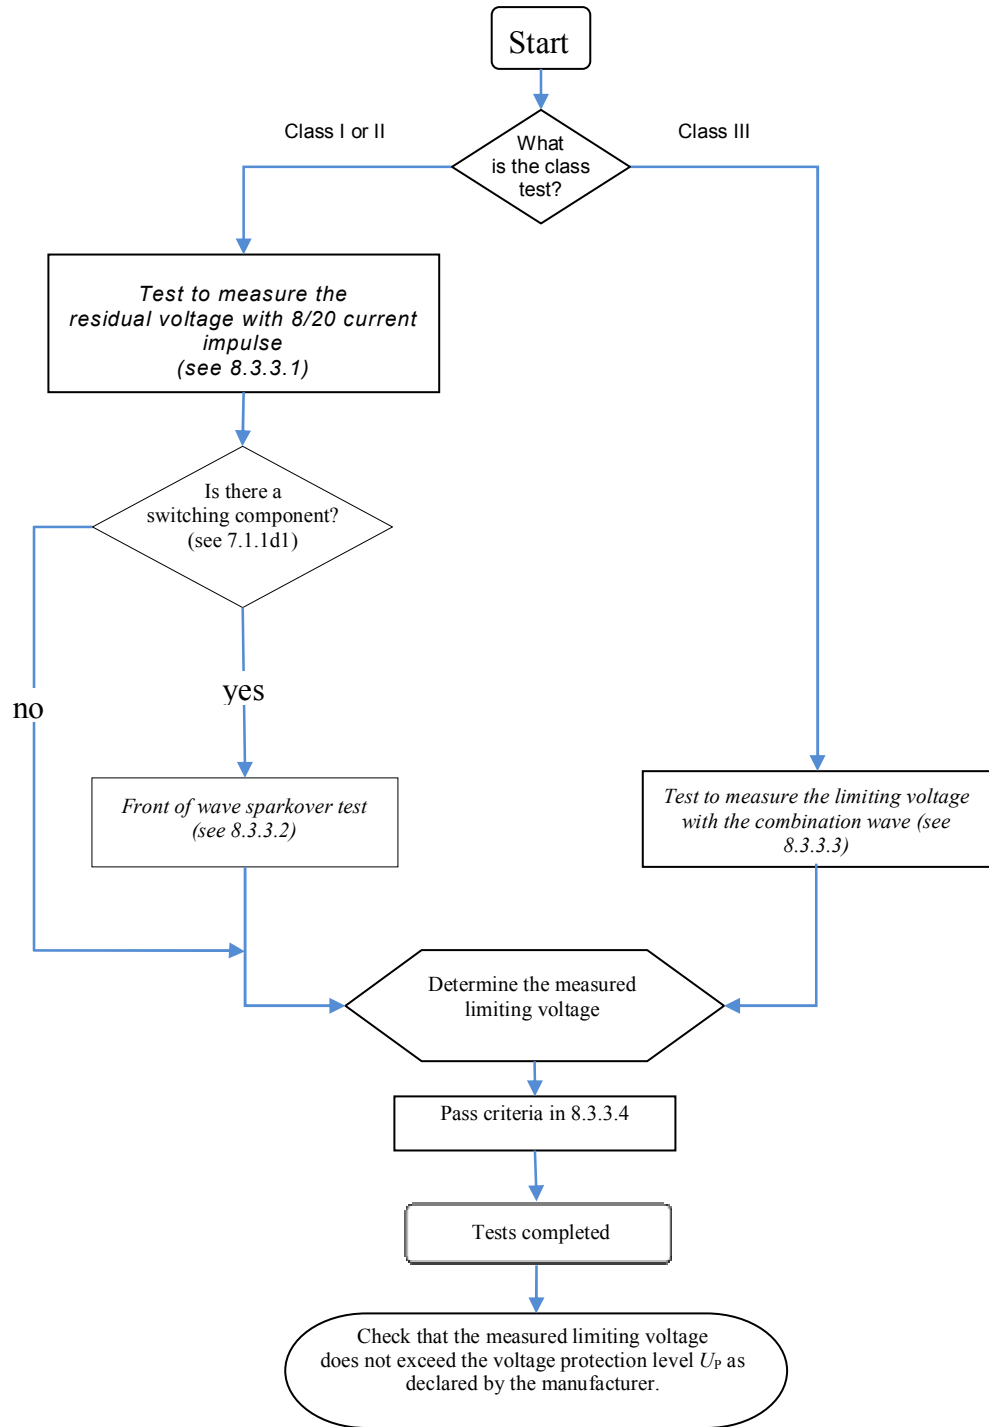
8.3.2 *Replace the 1st paragraph to read:*

All modes of protection of the SPD shall be connected as for normal use according to the manufacturer's instructions.

The line to PE voltage of the supply system shall be adjusted to the reference test voltage U_{REF} .

8.3.3

Replace Figure 5 by:



8.3.3.1 *Replace the whole clause by*

Residual voltage with 8/20 current impulses

- a) When testing SPDs to class I, 8/20 current impulses with a sequence of crest values of approximately 0,1; 0,2; 0,5; 1,0 times the crest value of I_{imp} shall be applied.

When testing SPDs to class II, 8/20 current impulses with a sequence of crest values of approximately 0,1; 0,2; 0,5; 1,0 times I_n shall be applied.

If the SPD contains only voltage-limiting components, this test needs only to be performed at crest values of I_{imp} for test class I or I_n for test class II.

One sequence of positive polarity and one sequence of negative polarity are applied to the SPD.

- b) When I_{max} is declared by the manufacturer an additional 8/20 current impulse with a crest value of I_{max} shall be applied at the polarity that showed higher residual voltages in the previous tests a).
- c) The interval between individual impulses shall be long enough for the sample to cool down to ambient temperature.
- d) A current and a voltage oscillogram shall be recorded for each impulse. If relevant, the (absolute) crest values shall be plotted into a discharge current versus residual voltage diagram to I_n or I_{imp} . A curve which best fits the data points shall be drawn. There shall be sufficient points on the curve to ensure that there are no significant deviations on the curve up to I_n or I_{imp} .
- e) The residual voltage used for determining the measured limiting voltage is the highest voltage value corresponding to the range of currents for
- class I: up to I_{imp} ;
 - class II: up to I_n .

NOTE The residual voltage is the highest crest value measured during surge current flow. Any high frequency disturbances and spikes before and during current flow caused by specific generator design, like crowbar generators, are disregarded.

- f) The value for determining U_{max} is the highest residual voltage measured at surge currents up to I_n , I_{max} or I_{imp} , as applicable depending on the SPD test class.

8.3.4.1 *Replace the 3rd and 4th paragraphs starting with "The measured limiting...." and ending with "...negative surge applied." to read:*

The measured limiting voltage shall be checked and shall be below or equal to U_P .

The measured limiting voltage shall be determined, using the tests described in 8.3.3, but the test of 8.3.3.1 is performed only with an 8/20-surge current with a crest value corresponding to I_{imp} for Test Class I or with I_n for Test Class II and the test of 8.3.3.3 is performed only at U_{oc} for Test class III.

8.3.4.2.2 *Replace the whole paragraph by:*

The test sample shall be connected to a power frequency voltage at U_c with a prospective short-circuit current equal to the short circuit current rating I_{scsr} declared by the manufacturer and with a power factor in accordance with Table 8, except for SPDs which are only connected between neutral and protective earth in TT- and/or TN-Systems, for which the prospective short-circuit current shall be at least 100 A.

8.3.5.2 *Add a note to the thermal stability test at the end of sample preparation:*

NOTE Separate prepared sets of samples may be needed for this test.

8.3.5.3 *Modify the text of 2nd paragraph of Test procedure in a) to read:*

**Test
Procedure**

The test is carried out twice with U_{REF} applied once at (45 ± 5) electrical degrees and once at (90 ± 5) electrical degrees after the zero crossing of the voltage

**8.3.5.3.1 and
Table 5** *Remove the entire part. And the relevant line in Table 5.*

8.3.5.3.2 *Add the sentence after the 2 bullets:*

For all types of SPDs with U_c up to 180 V, the conditioning voltage may be reduced to 600 V" if for voltage switching type SPDs and for combination type SPDs, any voltage switching components operate at this voltage.

8.3.5.3.2 *Replace the full last paragraph of Test procedure by:*

**Test
Procedure**

If all measurements of the tests on the first set of samples (100 A test set up):

- either show a disconnection within 5 s during the application of the conditioning voltage

or

- the current through the sample during the application of U_{REF} after conditioning does not exceed a value of 1 mA,

or

- the current through the sample during the application of U_{REF} after conditioning does not exceed the initial value determined at U_{REF} before the test by more than 20 %

no further test is performed.

8.3.5.3.2 *Modify in the pass criteria the 2nd bullet of the exception as follows:*

Pass Criteria

SPDs where the current is interrupted or no significant current flows during the application of U_{REF} .

8.3.5.3.2 *Add the note after the text "where no disconnection occurs"*

Pass criteria

NOTE Significant current means that the current through the sample during the application of U_{REF} after conditioning does not exceed a value of 1 mA or does not exceed the initial value determined at U_{REF} before the test by more than 20 %.

8.4.2.1.1 *Remove column "American Wire Gauge"*

Table 11

8.4.3 *Modify pass criteria to read:*

Pass criteria

The air clearances and creepage distances shall not be smaller than the values indicated in Table 15 and Table 16, whereby Table 16 shall be applied to items 1), 2) and 3) according to Table 15.

8.4.3 *Move footnote ^a from first column U_{max} to second column $\leq 2\ 000V$*

Table 15

8.6.1.1 *Remove column AWG/MCM*

Table 19

8.6.1.1 *Modify the pass criteria text to read:*

The pass criteria **C**, **F** and **G** according to Table 4 and the following additional pass criteria shall apply.

8.6.1.2 *Replace* "If a maximum overcurrent protection is specified by the manufacturer, the SPD shall be loaded for 1 h with a current equal to k times that maximum overcurrent protection. The factor k shall be selected from Table 20."

by





"If an external maximum overcurrent protection is specified by the manufacturer, the SPD shall be loaded for 1 h with a current equal to 1,6 times the rated current of that maximum overcurrent protection."





8.6.1.2**Table 20****Annex A,****Table A.1**

Delete Table 20 but *keep* the numbering (add void)

Replace Table A.1 by

Table A.1 — Reference test voltage values

Power distribution system		Nominal AC system Voltage[V] L-PE(N) / L-L	Expected voltage regulation of the power distribution system max+(%)	Reference test voltage U_{REF} [V] (depending on the mode of protection)			
				L-N (PEN)	L-PE	L-L	N-PE
Three phase TT-system without PE and Neutral distribution 	3 conductor	U_{L-PE}/U_{L-L}	Tol	---	$(1+Tol/100) \cdot U_{L-PE}$	$(1+Tol/100) \cdot U_{L-L}$	---
	e.g.						
Three phase TT-system with Neutral distribution 	4 conductor	U_{L-PE}/U_{L-L}	Tol	$(1+Tol/100) \cdot U_{L-PE}$	$(1+Tol/100) \cdot U_{L-PE}$	$(1+Tol/100) \cdot U_{L-L}$	$(1+Tol/100) \cdot U_{L-PE}$
	e.g.						
Three phase TN-C-system with PEN-distribution 	4 conductor	U_{L-PE}/U_{L-L}	Tol	$(1+Tol/100) \cdot U_{L-PE}$	$(1+Tol/100) \cdot U_{L-PE}$	$(1+Tol/100) \cdot U_{L-L}$	---
	e.g.						
Three phase TN-S-system with PE and Neutral distribution 	5 conductor	U_{L-PE}/U_{L-L}	Tol	$(1+Tol/100) \cdot U_{L-PE}$	$(1+Tol/100) \cdot U_{L-PE}$	$(1+Tol/100) \cdot U_{L-L}$	$(1+Tol/100) \cdot U_{L-PE}$

Power distribution system	Nominal AC system Voltage[V] L-PE(N) / L-L	Expected voltage regulation of the power distribution system max+(%)	Reference test voltage U_{REF} [V] (depending on the mode of protection)				
			L-N (PEN)	L-PE	L-L	N-PE	
							
e.g.	230 / 400	10	255	255	440	255	
Three phase IT-system with Neutral distribution 	U_{L-N}/U_{L-L}	Tol	$(1+Tol/100) \cdot U_{L-N}$	$(1+Tol/100) \cdot U_{L-L}$	$(1+Tol/100) \cdot U_{L-L}$	$(1+Tol/100) \cdot U_{L-N}$	
e.g.	230 / 400	10	255	440	440	255	
Three phase IT-system without Neutral distribution 	$---/U_{L-L}$	Tol	---	$(1+Tol/100) \cdot U_{L-L}$	$(1+Tol/100) \cdot U_{L-L}$	---	
e.g.	$---/230$	10	---	255	255	---	
Single-phase TN-S-system 	$U_{L-PE}/---$	Tol	$(1+Tol/100) \cdot U_{L-PE}$	$(1+Tol/100) \cdot U_{L-PE}$	---	$(1+Tol/100) \cdot U_{L-PE}$	
e.g.	230/---	10	255	255	---	255	

NOTE: If higher voltage regulation is required for certain applications (for example + 15 %), subject to a special agreement between the manufacturer and the user.

Annex B Remove Table B.2 and Table B.3 and text related to B.2 and B.3.

Annex B, B.1 Modify as follows:

For specific applications with conditions different from the ones given in Table B.1, the TOV test values U_T and the testing duration may be defined by agreement between the manufacturer and the user, depending on actual network configurations and conditions. The values of U_T and the corresponding duration(s) shall be declared on the SPDs data sheet according to 7.1.1 c1).

Annex D Table D.1 Add in sequence 1 after thermal stability : ^c

- Annex D** *Replace the test description in test sequence 7 "For SPDs classified outdoor" to read:*
Table D.1 Environmental tests for outdoor SPDs
- Annex ZA** *Add Annex ZA (See annexes)*
- Annex ZB** *Add Annex ZB (See annexes)*
- Bibliography** *Add the following references:*
- EN 60068-2-6, *Environmental testing – Part 2-6: Tests – Test Fc: Vibration (sinusoidal) (IEC 60068-2-6)*
- EN 60068-2-27, *Environmental testing – Part 2-27: Tests – Test Ea and guidance: Shock IEC 60068-2-27)*
- EN 60068-2-64, *Environmental testing – Part 2-64: Tests – Test Fh: Vibration, broadband random and guidance (IEC 60068-2-64)*
- EN 60721-3-3, *Classification of environmental conditions – Part 3: Classification of groups of environmental parameters and their severities – Section 3: Stationary use at weather protected locations (IEC 60721-3-3)*
- EN 61373, *Railway applications – Rolling stock equipment – Shock and vibration tests (IEC 61373)*
- HD 60364-5-534, *Low-voltage electrical installations – Part 5-53: Selection and erection of electrical equipment – Isolation, switching and control – Clause 534: Devices for protection against overvoltages (IEC 60364-5-53:2001/A1 (CLAUSE 534))*

Annex ZA (normative)

Normative references to international publications with their corresponding European publications

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

NOTE When an international publication has been modified by common modifications, indicated by (mod), the relevant EN/HD applies.

<u>Publication</u>	<u>Year</u>	<u>Title</u>	<u>EN/HD</u>	<u>Year</u>
IEC 60060-1 + corr. March + corr. March	1989 1990 1992	High-voltage test techniques - Part 1: General definitions and test requirements	HD 588.1 S1 ¹⁾	1991
IEC 60112	-	Method for the determination of the proof and the comparative tracking indices of solid insulating materials	EN 60112	-
IEC 60529	-	Degrees of protection provided by enclosures (IP Code)	EN 60529	-
IEC 60664-1	2007	Insulation coordination for equipment within low-voltage systems - Part 1: Principles, requirements and tests	EN 60664-1	2007
IEC 60695-2-11 + corr. January	2000 2001	Fire hazard testing - Part 2-11: Glowing/hot-wire based test methods - Glow-wire flammability test method for end- products	EN 60695-2-11	2001
IEC 61000	series	Electromagnetic compatibility (EMC)	EN 61000	series
IEC 61180-1	-	High-voltage test techniques for low-voltage equipment - Part 1: Definitions, test and procedure requirements	EN 61180-1	-
IEC 60364	series	Electrical installations of buildings / Low-voltage electrical installations	HD 384 / HD 60364	series
IEC 62368-1	2014	Audio/video, information and communication technology equipment - Part 1: Safety requirements	EN 62368-1	2014 (mod)

1) HD 588.1 S1 is superseded by EN 60060-1:2010, which is based on IEC 60060-1:2010.

Annex ZB (informative)

Vibration and shock test

ZB.1 General

This annex gives information if the manufacturer declares performances for vibration and shock conditions.

ZB.2 Vibration and shock test

ZB.2.1 General

Vibration and shock tests shall be performed according to

- EN 60068-2-6 for sinusoidal vibration test,
- EN 60068-2-64 for broadband random vibration test, and
- EN 60068-2-27 for shock test.

ZB.2.2 Transportation

Usually SPDs within their packaging are subjected to mechanical stress due to transportation. This should be checked by a vibration and shock test in accordance with EN 60721-3-2.

ZB.2.3 Special applications

Special applications of SPDs may require additional vibration and shock tests, on the device itself.

Typical values can be found in EN 60721-3-3. The typical values can be as shown in Table ZB.1.

Table ZB.1 — Typical Vibration and shock test parameters for various environments

Environment	EN 60721-3-3 references	Sinusoidal vibrations	Shock	Random Vibrations
Commercial building	3M3	0,75 mm 0,2g FT 8 Hz 1-150 Hz 5 cycles	5g 6ms	NA
Industrial	3M4	3,5 mm 1g FT 8,5 Hz 1-150 Hz 10 cycles	15g 11ms	15g 6ms 100/axe/sens
Severe industrial	3M5	3,5 mm 1g FT 8,5 Hz 1-150 Hz 10 cycles	30g 6ms	25g 6ms 100/axe/sens
Hard	3M6	7,5 mm 2g FT 8 Hz 1-150 Hz 10 cycles	30g 6ms	25g 6ms 100/axe/sens
Extreme	3M8	15 mm 5g FT 9 Hz 1-150 Hz 5 cycles	30g 6ms	25g 6ms 100/axe/sens

Furthermore other applications like railway may require different parameters that are given in corresponding standards or directly from application. For instance required parameters for railway vibration and shock tests are given in EN 61373.

During the sinusoidal and random vibration tests (if requested), the sample should be powered under U_c with a short circuit capability of at least 5A.

ZB.3 Pass criteria

Pass criteria C, D, E, G and I according to Table 4 shall apply.

Annex ZC (normative)

Additional requirements for portable SPDs classified as pluggable equipment type A

Annex ZC applies to portable SPDs classified as pluggable equipment type A according to EN 62368-1.

NOTE A pluggable equipment type A is an equipment that is intended for connection to the mains via a non-industrial plug and socket-outlet or via a non-industrial appliance coupler, or both. These equipment are dedicated to household and similar uses.

It does not apply to

- portable SPDs for industrial and similar use,
- portable SPDs that are designed to be permanently connected to the fixed installation with a reliable earth (e.g. mounted in 19" racks).

If not otherwise mentioned, Annex ZC amends specific requirements of this European Standard. All requirements not mentioned in this annex shall be applied unchanged as provided in Table 3.

In Clause ZC.x below, the same numbering of the sub-clauses has been kept as in the main document.

ZC.7.7 Specific requirements for portable SPDs classified as pluggable equipment type A

For portable SPDs considered as pluggable equipment type A, the following specific requirements apply.

- Every mode of protection shall be provided with an appropriate internal disconnecter(s). No external disconnecters shall be required. All tests shall be passed by the SPD itself.
- Live terminals shall not be specifically assigned to a line terminal or to a neutral terminal. All live terminals shall be tested in the same way (due to possible inversion).
- No exceptions related to N-PE mode of protection of the main document apply to portable SPDs.
- Wherever disconnecter operation is required, it shall be provided by internal disconnecter(s).
- Internal disconnecters dedicated to the SPD function shall not be resettable or replaceable.
- The short circuit current rating I_{scor} shall not be lower than 1 500 A.
- All possible protection modes shall be tested, i.e. live to live and live to PE, when applicable.
- Voltage limiting components shall be rated to a minimum value of 1,25 times the nominal rated voltage of the system for which the SPD is designed, e.g. 230 V + 25 % min. for 230 V AC systems. When a mode of protection contains more than one voltage limiting component in series, this requirement applies to the sum of the voltage ratings of all voltage limiting components connected in series.

For SPDs with no protection mode connected to PE, no additional requirement applies.

For SPDs with a protection mode connected to PE, this protection mode shall consist of at least one voltage limiting component (e.g. MOV) and one voltage switching component (e.g. GDT) connected in series.

Portable multiservice SPDs designed to protect more than one kind of service e.g. power, data, and telecom system, shall be provided with modes of protection referring to a common reference point.

NOTE: This common reference point is normally connected to PE or the equipotential bonding system of the fixed installation

All clearances and creepage distances, including distances along outer surfaces of components, shall comply with the requirements for basic insulation of overvoltage category II and pollution degree 2.

Compliance is checked by visual inspection and the relevant tests of Clause 8 in conjunction with this Annex ZC.

ZC.8.3.5.3 Short-circuit current behaviour tests

b) Test at low short-circuit current

The prospective short-circuit current shall be set to 100 A.

Pass criteria

Pass criteria **C, H, I, J, K, M** and **N** according to Table 4 shall apply.

ZC.8.3.5.3.2 Additional test for SPD's failure mode simulation

Pass criteria

Pass criteria **C, H, I, J, M** and **N** according to Table 4 shall apply.

ZC.8.3.8 Behaviour under temporary overvoltages (TOVs)

Tests are applied:

- between live terminals;
- between live terminals and PE, if applicable.

Table B.1 is replaced by Table ZC.B.1 with conditions corresponding to the worse conditions of TT and TN systems. U_{ref} is set to minimum 255 V AC.

NOTE For household and similar use, installations fed by IT system are limited to the line-to-line a.c system voltages (without distributed neutral conductor).

Table ZC.B.1 – TOV test values for systems complying with IEC 60364 series for portable SPDs

	For $t_T = 5$ s (LV-system faults in consumer installation)	For $t_T = 120$ min (LV-system faults in distribution system and loss of neutral)	For $t_T = 200$ ms (HV- system faults) (requirement in 7.2.8.2 and test in 8.3.8.2)
	Withstand mode required	Withstand mode or safe failure mode required	Safe failure mode required ^a
Tests between live terminals	$1,32 \times U_{REF}$	$\sqrt{3} \times U_{REF}$	Not applicable
Tests between live – PE ^a	$\sqrt{3} \times U_{REF}$	$\sqrt{3} \times U_{REF}$	$1\ 200 + U_{REF}$
^a Applicable for SPDs with protection mode connected to PE			

ZC.8.3.8.2 TOVs caused by faults in the high (medium) voltage system

The prospective short-circuit current of the power source for U_{REF} shall be set to 100 A.

Annex ZZ
 (informative)

Relationship between this European standard and the safety objectives of Directive 2014/35/EU [2014 OJ L96] aimed to be covered

This European Standard has been prepared under a Commission's standardization request relating to harmonized standards in the field of the Low Voltage Directive, M/511, to provide one voluntary means of conforming to safety objectives of Directive 2014/35/EU of the European Parliament and of the Council of 26 February 2014 on the harmonization of the laws of the Member States relating to the making available on the market of electrical equipment designed for use within certain voltage limits [2014 OJ L96].

Once this standard is cited in the Official Journal of the European Union under that Directive, compliance with the normative clauses of this standard given in Table ZZ.1 confers, within the limits of the scope of this standard, a presumption of conformity with the corresponding essential requirements of that Directive, and associated EFTA regulations.

Table ZZ.1 – Correspondence between this European standard and Article 3 of Directive 2014/53/EU [2014 OJ L153]

Safety Objectives of Directive 2014/35/EU	Clause(s) / sub-clause(s) of this EN	Remarks / Notes
(1)(a)	1, 2, 3, 4, 5, 7.1, 8.2, Annex ZC, Annex D	
(1)(b)	7.1, 7.3, 8.2, 8.4, Annex ZC, Annex D	
(1)(c)	4, 8.1, Annex ZC, Annex D	
(2) (a)	5.5, 7.2.1, 7.2.2, 8.3.1, 8.3.2, all tests for which pass criteria C, E, I apply, all tests for which H, J apply, 9, Annex ZC, Annex D	
(2) (b)	7.2.4, 7.2.5, 7.2.5.2, 7.2.8, 7.5.1, 7.5.4, 8.3.4, 8.3.5 and annex ZC, 8.3.5.2, 8.3.8 and annex ZC, 8.6.1 and 8.6.4, 9, Annex D	
(2) (c)	7.4.5.1 and 7.4.5.2, 9, Annex ZC, Annex D	
(2) (d)	7.2.6, 7.2.7, 7.3.4, 7.5.2, 8.3.6, 8.3.7, 8.4.3 and Annex F.3, Annex ZC, Annex D	
(3) (a)	7.3.5, 7.6.1.3, 8.4.4, 9 and annex ZB, Annex ZC, Annex D	
(3) (b)	7.4.2, 7.4.3, 7.5.2, 8.3.5.1, 8.5.2, 8.5.3, 8.5.4 and Annexes F.1, F.2, F4 and F.5, 9, Annex ZC, Annex D	
(3) (c)	7.2.5, 7.2.8, 7.5.1, 7.5.4, 8.3.5, 8.3.8, 8.6.1 and 8.6.4, 9, Annex ZC, Annex D	

WARNING 1 — Presumption of conformity stays valid only as long as a reference to this European standard is maintained in the list published in the Official Journal of the European Union. Users of this standard should consult frequently the latest list published in the Official Journal of the European Union.

WARNING 2 — Other Union legislation may be applicable to the product(s) falling within the scope of this standard.

CONTENTS

FOREWORD.....	7
INTRODUCTION.....	9
1 Scope.....	10
2 Normative references.....	10
3 Terms, definitions and abbreviations.....	10
3.1 Terms and definitions.....	11
3.2 Abbreviations.....	16
4 Service conditions.....	18
4.1 Frequency.....	18
4.2 Voltage.....	18
4.3 Air pressure and altitude.....	18
4.4 Temperatures.....	18
4.5 Humidity.....	18
5 Classification.....	18
5.1 Number of ports.....	18
5.1.1 One.....	18
5.1.2 Two.....	18
5.2 SPD design.....	18
5.2.1 Voltage switching.....	18
5.2.2 Voltage limiting.....	18
5.2.3 Combination.....	18
5.3 Class I, II and III tests.....	18
5.4 Location.....	19
5.4.1 Indoor.....	19
5.4.2 Outdoor.....	19
5.5 Accessibility.....	19
5.5.1 Accessible.....	19
5.5.2 Inaccessible.....	19
5.6 Mounting method.....	19
5.6.1 Fixed.....	19
5.6.2 Portable.....	19
5.7 Disconnectors (including overcurrent protection).....	19
5.7.1 Location.....	19
5.7.2 Protection functions.....	19
5.8 Degree of protection provided by enclosures.....	19
5.9 Temperature and humidity range.....	20
5.9.1 Normal.....	20
5.9.2 Extended.....	20
5.10 Power system.....	20
5.10.1 AC between 47 Hz and 63 Hz.....	20
5.10.2 AC other than the range of 47 Hz to 63 Hz.....	20
5.11 Multipole SPD.....	20
5.12 SPD failure behaviour.....	20
5.12.1 open circuit (standard type SPD).....	20
5.12.2 short-circuit (short-circuiting type SPD).....	20

6	Preferred values for SPD	20
6.1	Preferred values of impulse discharge current I_{imp} for class I tests	20
6.2	Preferred values of nominal discharge current for class II tests I_n	20
6.3	Preferred values of open-circuit voltage for class III tests U_{oc}	20
6.4	Preferred values of voltage protection level U_p	20
6.5	Preferred values of r.m.s. maximum continuous operating voltage U_c	20
7	Requirements	21
7.1	General requirements	21
7.1.1	Identification	21
7.1.2	Marking	22
7.2	Electrical requirements	22
7.2.1	Protection against direct contact	22
7.2.2	Residual current I_{pE}	23
7.2.3	Voltage protection level U_p	23
7.2.4	Operating duty	23
7.2.5	Disconnectors and status indicators	23
7.2.6	Insulation resistance	24
7.2.7	Dielectric withstand	24
7.2.8	Behaviour under Temporary Overvoltages	24
7.3	Mechanical requirements	25
7.3.1	Mounting	25
7.3.2	Screws, current carrying parts and connections	25
7.3.3	External connections	25
7.3.4	Air clearances and creepage distances	27
7.3.5	Mechanical strength	27
7.4	Environmental and material requirements	27
7.4.1	Protection provided by enclosure (IP code)	27
7.4.2	Heat resistance	27
7.4.3	Fire resistance	27
7.4.4	Tracking resistance	27
7.4.5	Electromagnetic compatibility	28
7.5	Additional requirements for specific SPD designs	28
7.5.1	Two port SPDs and one port SPDs with separate input/output terminals	28
7.5.2	Environmental tests for outdoor SPDs	28
7.5.3	SPDs with separate isolated circuits	28
7.5.4	Short-circuiting type SPDs	29
7.6	Additional requirements as may be declared by the manufacturer	29
7.6.1	One-port and two-port SPDs	29
7.6.2	Two port SPDs only	29
8	Type tests	29
8.1	General testing procedures	30
8.1.1	Impulse discharge current used for class I additional duty test	36
8.1.2	Current impulse used for class I and class II residual voltage and operating duty tests	36
8.1.3	Voltage impulse used for class I and II sparkover tests	37
8.1.4	Combination wave used for class III tests	37
8.2	Indelibility of markings	40
8.3	Electrical tests	40

8.3.1	Protection against direct contact.....	40
8.3.2	Residual current I_{PE}	40
8.3.3	Measured limiting voltage.....	41
8.3.4	Operating duty test.....	44
8.3.5	Disconnectors and safety performance of overstressed SPDs.....	48
8.3.6	Insulation resistance.....	54
8.3.7	Dielectric withstand.....	55
8.3.8	Behaviour under Temporary Overvoltages (TOVs).....	56
8.4	Mechanical tests.....	60
8.4.1	Reliability of screws, current-carrying parts and connections.....	60
8.4.2	Terminals for external conductors.....	61
8.4.3	Verification of air clearances and creepage distances.....	65
8.4.4	Mechanical strength.....	68
8.5	Environmental and material tests.....	72
8.5.1	Resistance to ingress of solid objects and to harmful ingress of water.....	72
8.5.2	Heat resistance.....	72
8.5.3	Ball pressure test.....	73
8.5.4	Resistance to abnormal heat and fire.....	74
8.5.5	Tracking resistance.....	75
8.6	Additional tests for specific SPD designs.....	75
8.6.1	Test for two-port SPDs and one-port SPDs with separate input/output terminals.....	75
8.6.2	Environmental tests for outdoor SPDs.....	78
8.6.3	SPDs with separate isolated circuits.....	78
8.6.4	Short-circuiting type SPDs.....	78
8.7	Additional tests for specific performance if declared by the manufacturer.....	78
8.7.1	Total discharge current test for multipole SPDs.....	78
8.7.2	Test to determine the voltage drop.....	79
8.7.3	Load-side surge withstand capability.....	79
8.7.4	Measurement of voltage rate of rise du/dt	80
9	Routine and acceptance tests.....	80
9.1	Routine tests.....	80
9.2	Acceptance tests.....	80
Annex A (normative)	Reference test voltages for SPDs U_{REF}	81
Annex B (normative)	TOV Ratings.....	86
Annex C (normative)	Tests to determine the presence of a switching component and the magnitude of the follow current.....	89
Annex D (normative)	Reduced test procedures.....	91
Annex E (informative)	Alternative circuits for testing SPDs under TOVs caused by faults in the high (medium) voltage system.....	93
Annex F (informative)	Environmental tests for outdoor SPDs.....	94
Annex G (normative)	Temperature rise limits.....	96
	Bibliography.....	97
	Figure 1 – Metallic screen test set-up.....	31
	Figure 2 – Example of a decoupling network for single-phase power.....	39
	Figure 3 – Example of a decoupling network for three-phase power.....	39
	Figure 4 – Alternate test for the measured limiting voltage.....	39

Figure 5 – Flow chart of testing to check the voltage protection level U_p	42
Figure 6 – Flow chart of the operating duty test	45
Figure 7 – Test set-up for operating duty test.....	46
Figure 8 – Operating duty test timing diagram for test classes I and II	47
Figure 9 – Additional duty test timing diagram for test class I.....	48
Figure 10 – Operating duty test timing diagram for test class III	48
Figure 11 – Test circuit for SPD with I_{fi} lower than the declared short-circuit rating.....	52
Figure 12 – Test circuit for SPD's failure mode simulation	53
Figure 13 – Timing diagram for SPD's failure mode simulation.....	53
Figure 14 – Example of a test circuit to perform the test under TOVs caused by faults in the low voltage system.....	57
Figure 15 – Timing diagram for the test under TOVs caused by faults in the low voltage system.....	57
Figure 16 – Example of circuit for testing SPDs for use in TT systems under TOVs caused by faults in high (medium) voltage system	59
Figure 17 – Timing diagram for use in testing SPDs under TOVs caused by faults in the high (medium) voltage system using circuit of Figure 16	60
Figure 18 – Test apparatus for impact test.....	69
Figure 19 – Striking element of the pendulum hammer.....	70
Figure 20 – Ball thrust tester.....	73
Figure 21 – Loading rod for ball thrust tester.....	73
Figure 22 – Examples for appropriate test circuits of the load side short-circuit test(s).....	77
Figure E.1 – Examples of a three-phase and single-phase circuit for use in testing SPDs under TOVs caused by faults in the high (medium) voltage system	93
Table 1 – List of Abbreviations.....	17
Table 2 – Class I, II and III tests	19
Table 3 – Type test requirements for SPDs.....	32
Table 4 – Common pass criteria for type tests	34
Table 5 – Cross reference for pass criteria versus type tests	35
Table 6 – Preferred parameters for class I test	36
Table 7 – Tests to be performed to determine the measured limiting voltage	43
Table 8 – Prospective short-circuit current and power factor	50
Table 9 – Dielectric withstand	55
Table 10 – Screw thread diameters and applied torques	61
Table 11 – Cross-sections of copper conductors for screw-type or screwless terminals	62
Table 12 – Pulling forces (screw terminals).....	63
Table 13 – Conductor dimensions	63
Table 14 – Pulling forces (screwless terminals)	64
Table 15 – Air clearances for SPDs	66
Table 16 – Creepage distances for SPDs.....	67
Table 17 – Relationship between material groups and classifications.....	68
Table 18 – Fall distances for impact requirements	71
Table 19 – Test conductors for rated load current test	75

Table 20 – Current factor k for overload behaviour	76
Table 21 – Tolerances for proportional surge currents	79
Table A.1 – Reference test voltage values	82
Table B.1 – TOV test values for systems complying with IEC 60364 series	86
Table B.2 – TOV test parameters for North American systems	87
Table B.3 – TOV test parameters for Japanese systems	88
Table D.1 – Reduced test procedure for SPDs complying with IEC 61643-1:2005	92
Table G.1 – Temperature-rise limits	96

INTERNATIONAL ELECTROTECHNICAL COMMISSION

LOW-VOLTAGE SURGE PROTECTIVE DEVICES –**Part 11: Surge protective devices connected
to low-voltage power systems –
Requirements and test methods**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 61643-11 has been prepared by subcommittee 37A: Low-voltage surge protective devices, of IEC technical committee 37: Surge arresters.

This first edition of IEC 61643-11 cancels and replaces the second edition of IEC 61643-1 published in 2005. This edition constitutes a technical revision.

The main changes with respect of the second edition of IEC 61643-1 are the complete restructuring and improvement of the test procedures and test sequences.

The text of this standard is based on the following documents:

FDIS	Report on voting
37A/229/FDIS	37A/232/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the IEC 61643 series can be found, under the general title *Low-voltage surge protective devices*, on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

NOTE The attention of National Committees is drawn to the fact that equipment manufacturers and testing organizations may need a transitional period following publication of a new, amended or revised IEC publication in which to make products in accordance with the new requirements and to equip themselves for conducting new or revised tests.

It is the recommendation of the committee that the content of this publication be adopted for national implementation not earlier than 12 months from the date of publication.

IMPORTANT – The “colour inside” logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this publication using a colour printer.

INTRODUCTION

This part of IEC 61643 addresses safety and performance tests for surge protective devices (SPDs).

There are three classes of tests:

The Class I test is intended to simulate partial conducted lightning current impulses. SPDs subjected to Class I test methods are generally recommended for locations at points of high exposure, e.g., line entrances to buildings protected by lightning protection systems.

SPDs tested to Class II or III test methods are subjected to impulses of shorter duration.

SPDs are tested on a “black box” basis as far as possible.

IEC 61643-12 addresses the selection and application principles of SPDs in practical situations.

LOW-VOLTAGE SURGE PROTECTIVE DEVICES –

Part 11: Surge protective devices connected to low-voltage power systems – Requirements and test methods

1 Scope

This part of IEC 61643 is applicable to devices for surge protection against indirect and direct effects of lightning or other transient overvoltages. These devices are packaged to be connected to 50/60 Hz a.c. power circuits, and equipment rated up to 1 000 V r.m.s. Performance characteristics, standard methods for testing and ratings are established. These devices contain at least one nonlinear component and are intended to limit surge voltages and divert surge currents.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60060-1:1989, *High-voltage test techniques – Part 1: General definitions and test requirements*

IEC 60112, *Method for the determination of the proof and the comparative tracking indices of solid insulating materials*

IEC 60529, *Degrees of protection provided by enclosures (IP Code)*

IEC 60664-1:2007, *Insulation coordination for equipment within low-voltage systems – Part 1: Principles, requirements and tests*

IEC 60695-2-11:2000, *Fire hazard testing – Part 2-11: Glowing/hot-wire based test methods – Glow-wire flammability test method for end-products*

IEC 61000 (all parts), *Electromagnetic compatibility (EMC)*

IEC 61180-1, *High-voltage test techniques for low voltage equipment – Part 1: Definitions, test and procedure requirements*

3 Terms, definitions and abbreviations

For the purposes of this document, the following terms, definitions and abbreviations apply.