




*NSF International Standard /  
American National Standard*

# NSF/ANSI 419 - 2015 Public Drinking Water Equipment Performance - Filtration

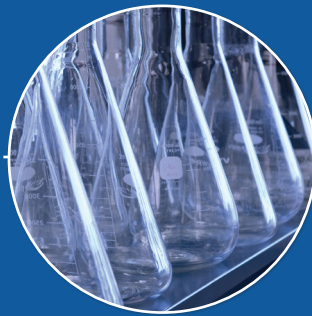

*NSF International, an independent, not-for-profit, non-governmental organization, is dedicated to being the leading global provider of public health and safety-based risk management solutions while serving the interests of all stakeholders.*

This Standard is subject to revision.  
Contact NSF to confirm this revision is current.

Users of this Standard may request clarifications and interpretations, or propose revisions by contacting:

Chair, Joint Committee on Public Drinking Water Equipment Performance  
c/o NSF International  
789 North Dixboro Road, P. O. Box 130140  
Ann Arbor, Michigan 48113-0140 USA  
Phone: (734) 769-8010 Telex: 753215 NSF INTL  
FAX: (734) 769-0109  
E-mail: [info@nsf.org](mailto:info@nsf.org)  
Web: <http://www.nsf.org>

NSF International Standard/  
American National Standard  
for Public Drinking Water  
Equipment Performance –

**Public Drinking Water  
Equipment Performance  
– Filtration**

Standard Developer  
**NSF International**

**NSF International**

**Designated as an ANSI Standard**  
January 2, 2015  
**American National Standards Institute**

Prepared by  
**The NSF Joint Committee on Public Drinking Water Equipment Performance**

Published by

**NSF International**  
**PO Box 130140, Ann Arbor, Michigan 48113-0140, USA**

For ordering copies or for making inquiries with regard to this Standard, please reference the designation “NSF/ANSI 419 – 2015.”

Copyright 2015 NSF International

Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from NSF International.

Printed in the United States of America.

## Disclaimers<sup>1</sup>

NSF, in performing its functions in accordance with its objectives, does not assume or undertake to discharge any responsibility of the manufacturer or any other party. The opinions and findings of NSF represent its professional judgment. NSF shall not be responsible to anyone for the use of or reliance upon this Standard by anyone. NSF shall not incur any obligation or liability for damages, including consequential damages, arising out of or in connection with the use, interpretation of, or reliance upon this Standard.

NSF Standards provide basic criteria to promote sanitation and protection of the public health. Provisions for mechanical and electrical safety have not been included in this Standard because governmental agencies or other national standards-setting organizations provide safety requirements.

Participation in NSF Standards development activities by regulatory agency representatives (federal, local, state) shall not constitute their agency's endorsement of NSF or any of its Standards.

Preference is given to the use of performance criteria measurable by examination or testing in NSF Standards development when such performance criteria may reasonably be used in lieu of design, materials, or construction criteria.

The illustrations, if provided, are intended to assist in understanding their adjacent standard requirements. However, the illustrations may not include **all** requirements for a specific product or unit, nor do they show the only method of fabricating such arrangements. Such partial drawings shall not be used to justify improper or incomplete design and construction.

Unless otherwise referenced, the annexes are not considered an integral part of NSF Standards. The annexes are provided as general guidelines to the manufacturer, regulatory agency, user, or certifying organization.

---

<sup>1</sup> The information contained in this Disclaimer is not part of this American National Standard (ANS) and has not been processed in accordance with ANSI's requirements for an ANS. Therefore, this Disclaimer may contain material that has not been subjected to public review or a consensus process. In addition, it does not contain requirements necessary for conformance to the Standard.

This page is intentionally left blank.

## Contents

1	General .....	1
1.1	Purpose .....	1
1.2	Scope .....	1
1.3	Alternate materials, designs, and construction .....	1
1.4	Minimum requirements for testing facility and equipment .....	1
1.5	Standard review .....	1
1.6	Significant figures .....	2
2	Normative references .....	2
3	Definitions .....	2
4	Materials .....	3
5	Bag and cartridge filter systems .....	3
5.1	General requirements .....	3
5.2	Experimental design .....	4
5.3	Challenge particulate .....	4
5.4	Apparatus .....	4
5.5	Flow rate .....	4
5.6	General test water .....	5
5.7	Set-up .....	5
5.8	Method .....	5
5.9	Analytical methods .....	6
6	Microfiltration and ultrafiltration membrane modules .....	7
6.1	General requirements .....	7
6.2	Challenge organisms .....	7
6.3	Apparatus .....	8
6.4	Flow rate .....	9
6.5	General test water .....	9
6.6	Set-up .....	9
6.7	Membrane integrity tests .....	9
6.8	Method .....	10
6.9	Analytical methods .....	10
Annex A	.....	A1
Annex B	.....	B1
Annex C	.....	C1
Annex D	.....	D1
Annex E	.....	E1

This page is intentionally left blank.



## Foreword<sup>2</sup>

The purpose of this Standard is to establish minimum performance requirements for filtration devices used in the treatment and production of public drinking water. The Standard describes the performance evaluation test procedure for the product specific challenge testing of full scale ultrafiltration (UF) and microfiltration (MF) membrane modules, bag filters, and cartridge filters for the removal of microbial contaminants. It provides procedures to develop challenge testing Log Removal Values (LRV<sub>C\_TEST</sub>), as required in the EPA's Long Term 2 Enhanced Surface Water Treatment Rule (LT2ESWTR) published in 40 CFR 141-subpart W<sup>3</sup>. The procedures in this Standard have been adapted from and are consistent with those applications described in the EPA's Membrane Filtration Guidance Manual (MFGM)<sup>4</sup>. Quality assurance/quality control procedures are also described under informational annexes to ensure that data generated from the testing will provide sound analytical results that can serve as the basis for the performance evaluation.

It is anticipated that alternative filtration technologies may be addressed under this Standard in the future.

This Standard was developed by the NSF Joint Committee on Public Drinking Water Equipment Performance with balanced input from industry, regulatory, and end-user groups using the consensus process described by the American National Standards Institute. The Standard incorporates NSF International's nearly two decades of experience managing the U.S. Environmental Protection Agency's Environmental Technology Verification Drinking Water Systems Center (ETV DWSC).

Suggestions for improvement of this Standard are welcome. This Standard is maintained on a Continuous Maintenance schedule and can be opened for comment at any time. Comments should be sent to Chair, Joint Committee on Public Drinking Water Equipment Performance at [standards@nsf.org](mailto:standards@nsf.org), or c/o NSF International, Standards Department, P.O. Box 130140, Ann Arbor, Michigan 48113-0140, USA.

---

<sup>2</sup> The information contained in this Foreword is not part of this American National Standard (ANS) and has not been processed in accordance with ANSI's requirements for an ANS. Therefore, this Foreword may contain material that has not been subjected to public review or a consensus process. In addition, it does not contain requirements necessary for conformance to the Standard.

<sup>3</sup> Superintendent of Documents, U.S. Government Printing Office, Washington, DC 20402 <[www.gpo.gov](http://www.gpo.gov)>.

<sup>4</sup> U.S. Environmental Protection Agency (USEPA), Office of Water, Washington, D.C. 20460 <[www.epa.gov](http://www.epa.gov)>

This page is intentionally left blank.

NSF/ANSI Standard  
for Public Drinking Water Equipment Performance –

Public Drinking Water Equipment Performance –  
Filtration

**1 General**

**1.1 Purpose**

It is the purpose of this Standard to establish minimum performance requirements for filtration devices used in the treatment and production of public drinking water.

**1.2 Scope**

This Standard is designed to describe the performance evaluation test procedure for the product specific challenge testing of full scale UF and MF membrane modules, bag filters, and cartridge filters for the removal of microbial contaminants. This Standard provides procedures to develop challenge testing Log Removal Values ( $LRV_{C\_TEST}$ ), as required in the EPA's Long Term 2 Enhanced Surface Water Treatment Rule (LT2ESWTR) published in 40 CFR 141-subpart W.

Evaluation of cleaning, maintenance and operation of the filtration equipment are not covered under the scope of this Standard.

**1.3 Alternate materials, designs, and construction**

While specific materials, designs, and construction are stipulated in this Standard, it is possible that systems that incorporate alternate materials, designs, and construction are acceptable when it is verified that such systems meet the applicable requirements stated herein.

**1.4 Minimum requirements for testing facility and equipment**

Testing should be performed at a test facility/laboratory such that the testing equipment at a minimum shall precisely and accurately control flow rate and has a flow meter upstream and/or downstream of the filter unit or membrane module; and shall ensure that the water is well mixed before sampling (e.g., static mixers or appropriate number of pipe lengths with good mixing confirmed).

**1.5 Standard review**

This Standard shall be reviewed at least once every five years. The review shall be conducted by the NSF Joint Committee on Public Drinking Water Equipment Performance.